


**PARALLEL CONSTRUCTION**  
NOT TO SCALE

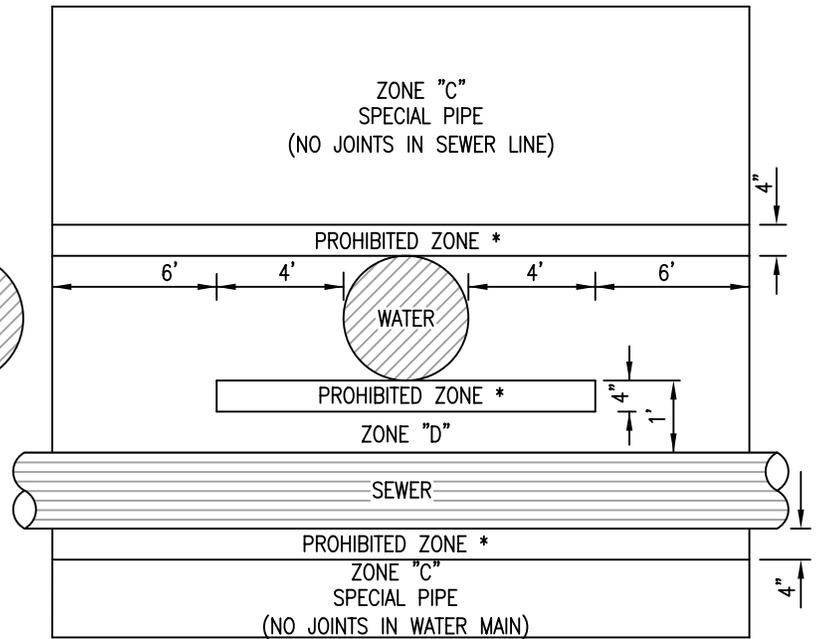

\* PER SECTION 64630 (E)(2) OF CCR TITLE 22

**CROSSINGS**  
NOT TO SCALE

ZONE	SEWER CONSTRUCTION REQUIREMENTS
A	SEWER LINES PARALLEL TO WATER MAINS SHALL <u>NOT</u> BE PERMITTED IN THIS ZONE WITHOUT SPECIFIC APPROVAL FROM THE CITY.
B	<ol style="list-style-type: none"> <li>1. PLASTIC SEWER PIPE WITH RUBBER RING JOINTS [PER ASTM D 3034] OR EQUIVALENT.</li> <li>2. DUCTILE IRON PIPE WITH COMPRESSION JOINTS.</li> </ol>
C	<ol style="list-style-type: none"> <li>1. DUCTILE IRON PIPE WITH HOT DIP BITUMINOUS COATING AND MECHANICAL JOINTS.</li> <li>2. A CONTINUOUS SECTION OF CLASS 200 [DR 14 PER AWWA C900] PLASTIC PIPE OR EQUIVALENT CENTERED OVER THE PIPE BEING CROSSED.</li> <li>3. ANY SEWER PIPE WITHIN A CONTINUOUS SLEEVE (EXCEPT V.C.P. &amp; A.B.S.).</li> </ol>
D	<ol style="list-style-type: none"> <li>1. A CONTINUOUS SECTION OF DUCTILE IRON PIPE WITH HOT DIP BITUMINOUS COATING.</li> <li>2. A CONTINUOUS SECTION OF CLASS 200 [DR 14 PER AWWA C900] PLASTIC PIPE OR EQUIVALENT. CENTERED ON THE PIPE BEING CLOSED.</li> <li>3. ANY SEWER PIPE WITHIN A CONTINUOUS SLEEVE (EXCEPT V.C.P &amp; ABS).</li> <li>4. ANY SEWER PIPE SEPARATED BY 10 FEET x 10 FEET, 4 INCHES THICK REINFORCED CONCRETE SLAB (EXCEPT V.C.P &amp; A.B.S.).</li> </ol>

APPROVED:  
/S/  
DIRECTOR OF PUBLIC WORKS  
Aug 28, 2006  
DATE

**CITY OF  
SIMI VALLEY**  
DEPARTMENT OF PUBLIC WORKS

**SEPARATION REQUIREMENTS  
FOR WATER AND  
WASTEWATER LINES**

STANDARD PLAN NO.  
**SV 40-10**  
SHEET 1 OF 1