


**ACCESS FRAME**


NOT TO SCALE

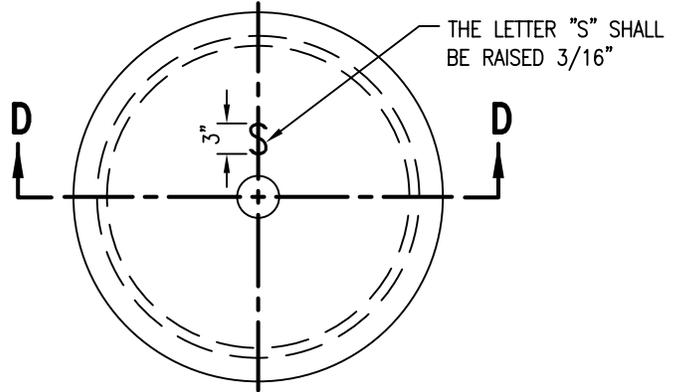

THE LETTER "S" SHALL BE RAISED 3/16"


**ACCESS COVER**

NOT TO SCALE

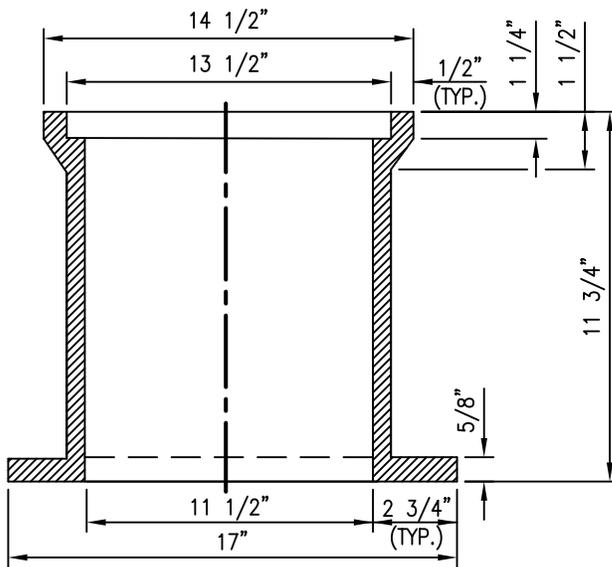

**SECTION C-C**

NOT TO SCALE

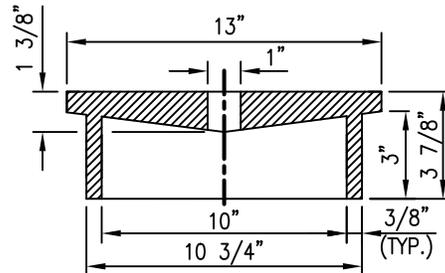

**SECTION D-D**

NOT TO SCALE

APPROVED:

/S/

DIRECTOR OF PUBLIC WORKS

Aug 28, 2006

DATE

CITY OF  
SIMI VALLEY

DEPARTMENT OF PUBLIC WORKS

TERMINAL CLEANOUT  
STRUCTURE  
TYPE 'A'

STANDARD PLAN NO.

SV 40-160

SHEET 2 OF 3

**NOTES:**

1. PIPE AND FITTINGS, EXCEPT AS OTHERWISE SHOWN HEREON, SHALL BE OF THE SAME MATERIAL AS THE SEWER, UNLESS APPROVED ADAPTERS ARE UTILIZED. PIPE MAY BE ANY OF THE FOLLOWING:
  - DUCTILE IRON
  - P.E. PIPE
  - P.V.C. PLASTIC PIPE.
2. PIPE AND FITTINGS SHALL BE PROPERLY ALIGNED AND MAINTAINED WHILE CONCRETE IS BEING PLACED AND CURED. JOINTS FOR PIPES AND FITTINGS SHALL BE MADE PRIOR TO PLACING CONCRETE. CONCRETE FOR BEDDING, ENCASEMENT, AND WALL SUPPORT FOR PIPES AND FITTINGS SHALL BE PLACED UNIFORMLY AROUND THE PIPE AND FITTINGS AS SHOWN HEREON TO MAINTAIN PROPER ALIGNMENT, AND SHALL BE CLASS 450-C-2000.
3. THE ACCESS FRAME, COVER AND CAP SHALL NOT BE PUNCHED OUT.
4. THE CONTRACTOR, MAY PLACE EITHER CIRCULAR OR SQUARE CONCRETE PIPE WALL SUPPORTS AS SHOWN.

<p><u>APPROVED:</u> /s/ DIRECTOR OF PUBLIC WORKS Aug 28, 2006 DATE</p>	<p>CITY OF SIMI VALLEY DEPARTMENT OF PUBLIC WORKS</p>	<p>TERMINAL CLEANOUT STRUCTURE TYPE 'A'</p>	<p><u>STANDARD PLAN NO.</u> SV 40-160 SHEET 3 OF 3</p>
--	---	---	--